

ALL WIRING SHOULD BE DONE BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH ARTICLE 455 OF THE NATIONAL ELECTRIC CODE® AND ALL OTHER APPLICABLE CODES.

SEE THE ROTO-CON MANUAL, ROTARY NAMEPLATE, PANEL NAMEPLATE, AND LOAD EQUIPMENT NAMEPLATES FOR AMPERAGE RATINGS AND OTHER IMPORTANT INFORMATION.

SEE ARTICLE 250 OF NEC® FOR PROPER GROUNDING OF ALL ENCLOSURES.


DO NOT CONNECT CONTROL TRANSFORMERS OR OTHER 1Ø LOADS TO "A" PHASE (PHASE WITH HIGHEST VOLTAGE TO GROUND) FROM THE CONVERTER.

480 VOLT
1Ø FUSED
DISCONNECT
SWITCH OR
BREAKER


SINGLE-PHASE CONDUCTORS
SIZED FOR FLA 1Ø

THREE-PHASE CONDUCTORS SIZED FOR LOAD IN
ACCORDANCE WITH NEC.

3Ø
DISCONNECTING
MEANS

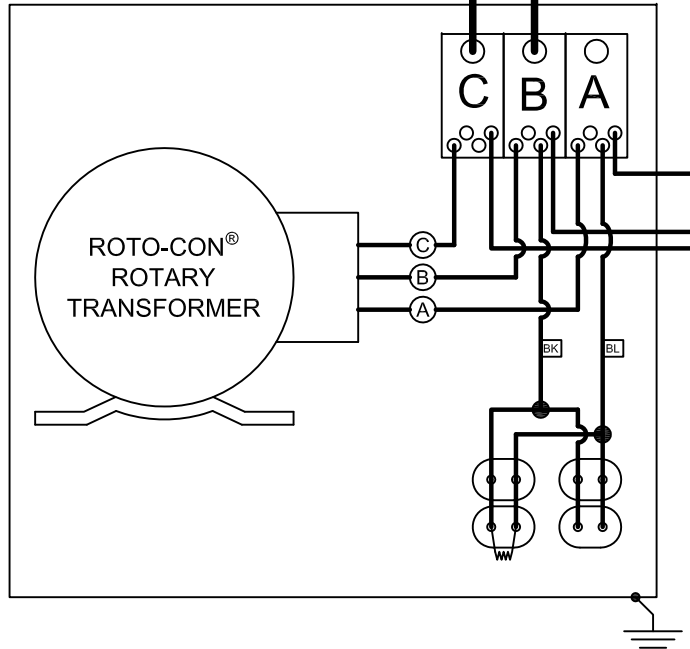

CAPACITOR PANEL MOUNTED TO ROTARY BASE UNIT

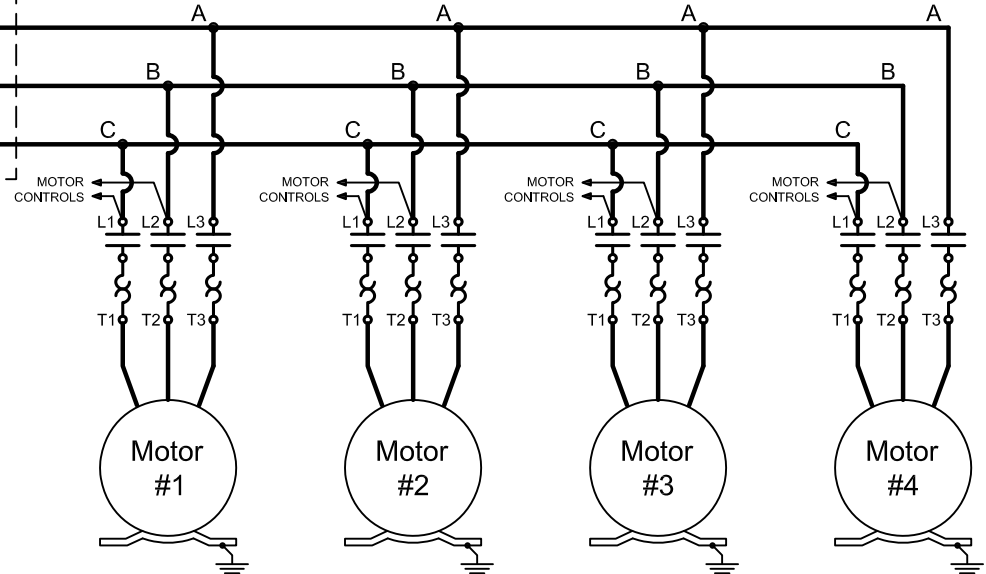

REVISIONS			ROTO-CON® MODEL 92 TYPE CP	
A	1/8/2014	NCL	RONK ELECTRICAL INDUSTRIES, INC. NOKOMIS, IL 62075	
			DRAWN - NCL	DRWG. NO. 3-1505A
			DATE - 1/8/2014	
			APP'D - NCL	